

**Overall Rating:** PASS**Report No:** 2021111021**Applicant:** Höpke Möbelstoff-Handels GmbH**Contact Person :** Hilmar CARL**Contact Telephone:** 095657960**Contact e-mail:** hilmar.carl@hoepke.de**Sample Accepted on:** 23.09.2021**Report Date:** 11.10.2021**Total number of pages:** 6 (Pg)**Sample ID:** RIO FR

	TEST	METHOD	RESULT
*	Fire behaviour of building materials and elements Part 1: Classification of building materials Requirements and testing	DIN 4102-1	PASS
			B2



Seal

Customer Representative
Merve Nur KIRVELİLaboratory Manager
Merve ÖZLÜ

EUROLAB LABORATUVAR HİZMETLERİ
TÜRCERT TEKNİK KONTROL VE BELGELENDİRME A.Ş.**EUROLAB® (TÜRCERT TEKNİK KONTROL VE BELGELENDİRME A.Ş.)**

It is prohibited to change any and all versions of this document in any manner whatsoever. In case of a conflict between the electronic version (e.g. PDF file) and the original paper version provided by EUROLAB®, the latter will prevail.

TÜRCERT Teknik Kontrol ve Belgelendirme A.Ş. disclaim liability for any direct, indirect, consequential or incidental damages that may result from the use of the information or data, or from the inability to use the information or data contained in this document.

The contents of this report may only be transmitted to third parties in its entirety and provided with the copyright notice,
prohibition to change, electronic versions' validity notice and disclaimer.

Environment

The requirements and standards apply to equipment intended for use in,

X	Residential (domestic) environment
X	Commercial and light-industrial environment
X	Industrial environment
X	Medical environment

EUROLAB LABORATUVAR HİZMETLERİ
TÜRCERT TEKNİK KONTROL VE BELGELENDİRME A.Ş.**DIN 4102-1****Scope**

The standard applies to the classification of the fire behavior of building materials to assess the risk as a single building material and in combination with other building materials.

Building Material Classes

The building materials are classified according to their fire behavior into the building material classes according to Table 1:

Building Material Classes	Building Inspectorate Designation
A A1 A2	Non-combustible building materials
B B1 B2 B3	Flammable building materials Flame retardant building materials Normally flammable building materials Easily flammable building materials

Building material class B2**Procedure:**

- Ignitability test: The ambient temperature of the test room is to be about 20 °C. Mount the specimen in the holder/frame and suspend the entire frame vertically in the cabinet. Position the burner vertically to set the flame height to 20 mm, then tilt the burner to a 45° angle and place it in the cabinet.
- For bottom edge ignition testing, position the burner so that flame is applied to the bottom edge of the specimen at the centre of its width and thickness. For specimens with a thickness greater than 3 mm, apply the flame to the lower surface of the specimen at the least favourable point in terms of fire behaviour. The front edge of the burner's stabilizer is to be 16 mm away from the specimen's bottom edge, measured along the nozzle axis.
- Where surface ignition testing is necessary, burner placement and flame impingement shall be. The flame shall be applied to the centre of the specimen's width.
- Apply the flame for 15 seconds and then pull the burner back, taking care not to create any draught. Measure the time it takes for the flame tip to reach the gauge mark.
- Multi-layered materials are to be tested and as specified in subclause, except that the flame is to be applied to the least favourable point on the specimen's front edge.
- If materials are to be used in composite structures together with other materials, these shall be tested together.

Requirements For Classification

Building materials, with the exception of floor coverings, meet the requirements for classification in building material class B1 if they pass the fire pit test and meet the requirements for building material class B2.


EUROLAB LABORATUVAR HİZMETLERİ
TÜRCERT TEKNİK KONTROL VE BELGELENDİRME A.Ş.

RESULTS

Row-no.	Foil-type:	Results of the Numune test (part 1) Measurements test specimen			
		RIO FR			
1	<u>No. of test specimen arrangement according to DIN 4102, part 15, table 1</u>	-			
2	<u>Max. flame height above bottom edge</u> cm Time ¹⁾ min : s	8 cm 10 s			
3	<u>Melt through / burn through</u> Time ¹⁾ min : s	-			
4	<u>Observations on the backside of the specimens</u> Flames/smouldering Time ¹⁾ min : s	-			
5	<u>Discolouration Time ¹⁾</u> min : s	20 s			
6	<u>Burning droplets</u> Start ¹⁾	-			
7	<u>Extent</u> sporadic burning droplets continually falling particles min : s	-			
8	<u>Falling particles which burns</u> Start ¹⁾ min : s	-			
9	sporadic falling parts	-			
10	continually falling particles	-			
11	<u>Duration of the burning on the screen bottom (max.)</u> min : s	120 s			
12	<u>Interference of the burner flame by dripping /falling particles</u> Time ¹⁾ min : s	-			
13	<u>Early termination of the test</u> End of burning at the specimen ¹⁾ min : s	-			
14	<u>Time of early cancellation of the test ¹⁾</u> min : s	-			
	<u>Continuous burning after termination of the test</u>	-			
15	<u>Duration</u> min : s	-			
16	<u>Number of specimens</u>	1			
17	<u>Front side of the specimen</u>	-			
18	<u>Back side of the specimen</u>	-			
19	<u>Flame length</u> cm	7 cm			
20	<u>Smouldering after termination of the test</u> Duration min : s	-			
21	<u>Number of specimens</u>	-			
	<u>Location</u>	-			

EUROLAB LABORATUVAR HİZMETLERİ
TÜRCERT TEKNİK KONTROL VE BELGELENDİRME A.Ş.

Row-no.	Foil-type:	Results of the Numune test (part 1)			
		Measurements test specimen			
		RIO FR			
22	Lower half of the specimens	-			
23	Upper half of the specimens	-			
24	Front side of the specimen	-			
	Backside of the specimen	-			
	<u>Smoke development</u>	-			
	< 400 % x min	-			
	> 400 % x min	-			
	Diagram in appendix	-			
	<u>Residual lengths</u>	-			
	Single values cm	-			
	Average values cm	-			
	Photo of the specimen on page	-			
	<u>Smoke temperature</u>	119 °C			
	Maximum value of the averaged values °C	-			
	Time ¹⁾ min : s	-			
	Diagram in appendix Nr.	-			

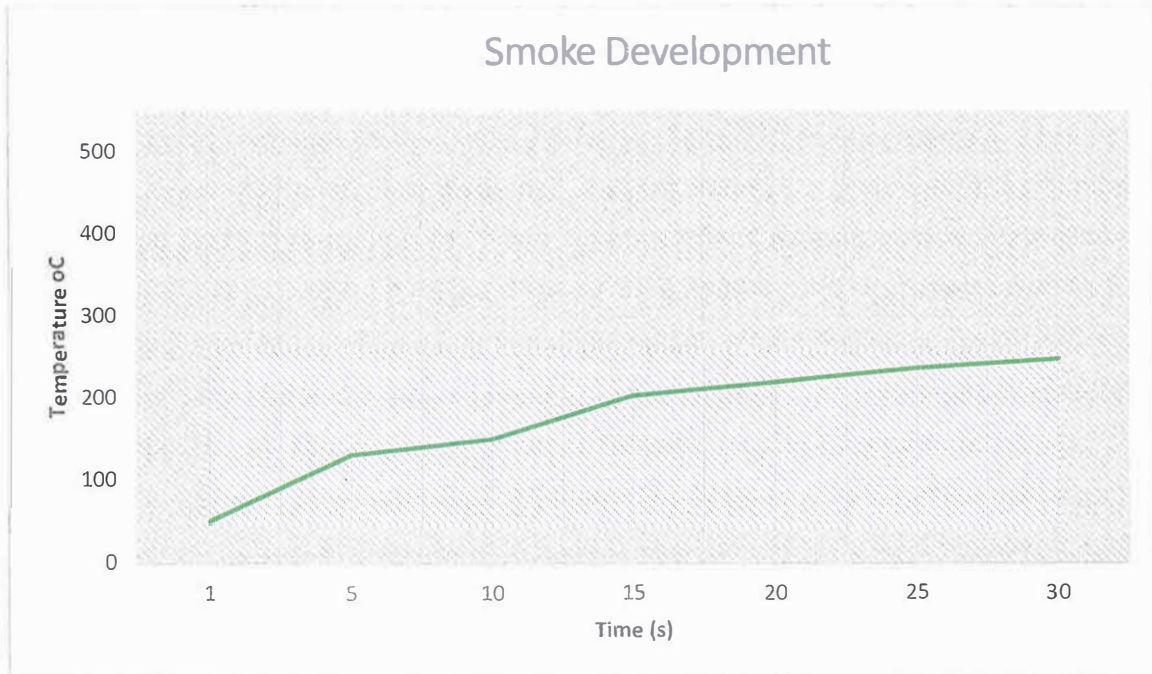

EUROLAB LABORATUVAR HİZMETLERİ
TÜRCERT TEKNİK KONTROL VE BELGELENDİRME A.Ş.

IMAGE OF SAMPLE



***** End of Report*****